


Escaline NB3Br freebase in DMSO-d6
NEO 400
1D Proton Spectrum
March 13, 2025.

Current Data Parameters
NAME Syntharise031325
EXPNO 420
PROCNO 1

F2 - Acquisition Parameters
Date_ 20250313
Time 14.08 h
INSTRUM Avance Neo 400
PROBHD Z104450_0313 (PA BBO 400)
PULPROG zg30
TD 65536
SOLVENT DMSO
NS 16
DS 0
SWH 8196.722 Hz
FIDRES 0.250144 Hz
AQ 3.9976959 sec
RG 101
DW 61.000 usec
DE 13.54 usec
TE 297.9 K
D1 0.10000000 sec
TD0 1
SFO1 400.3424721 MHz
NUC1 1H
P0 3.33 usec
P1 10.00 usec
PLW1 14.20300007 W


F2 - Processing parameters
SI 65536
SF 400.3400060 MHz
WDW EM
SSB 0
LB 0.30 Hz
GB 0
PC 1.00

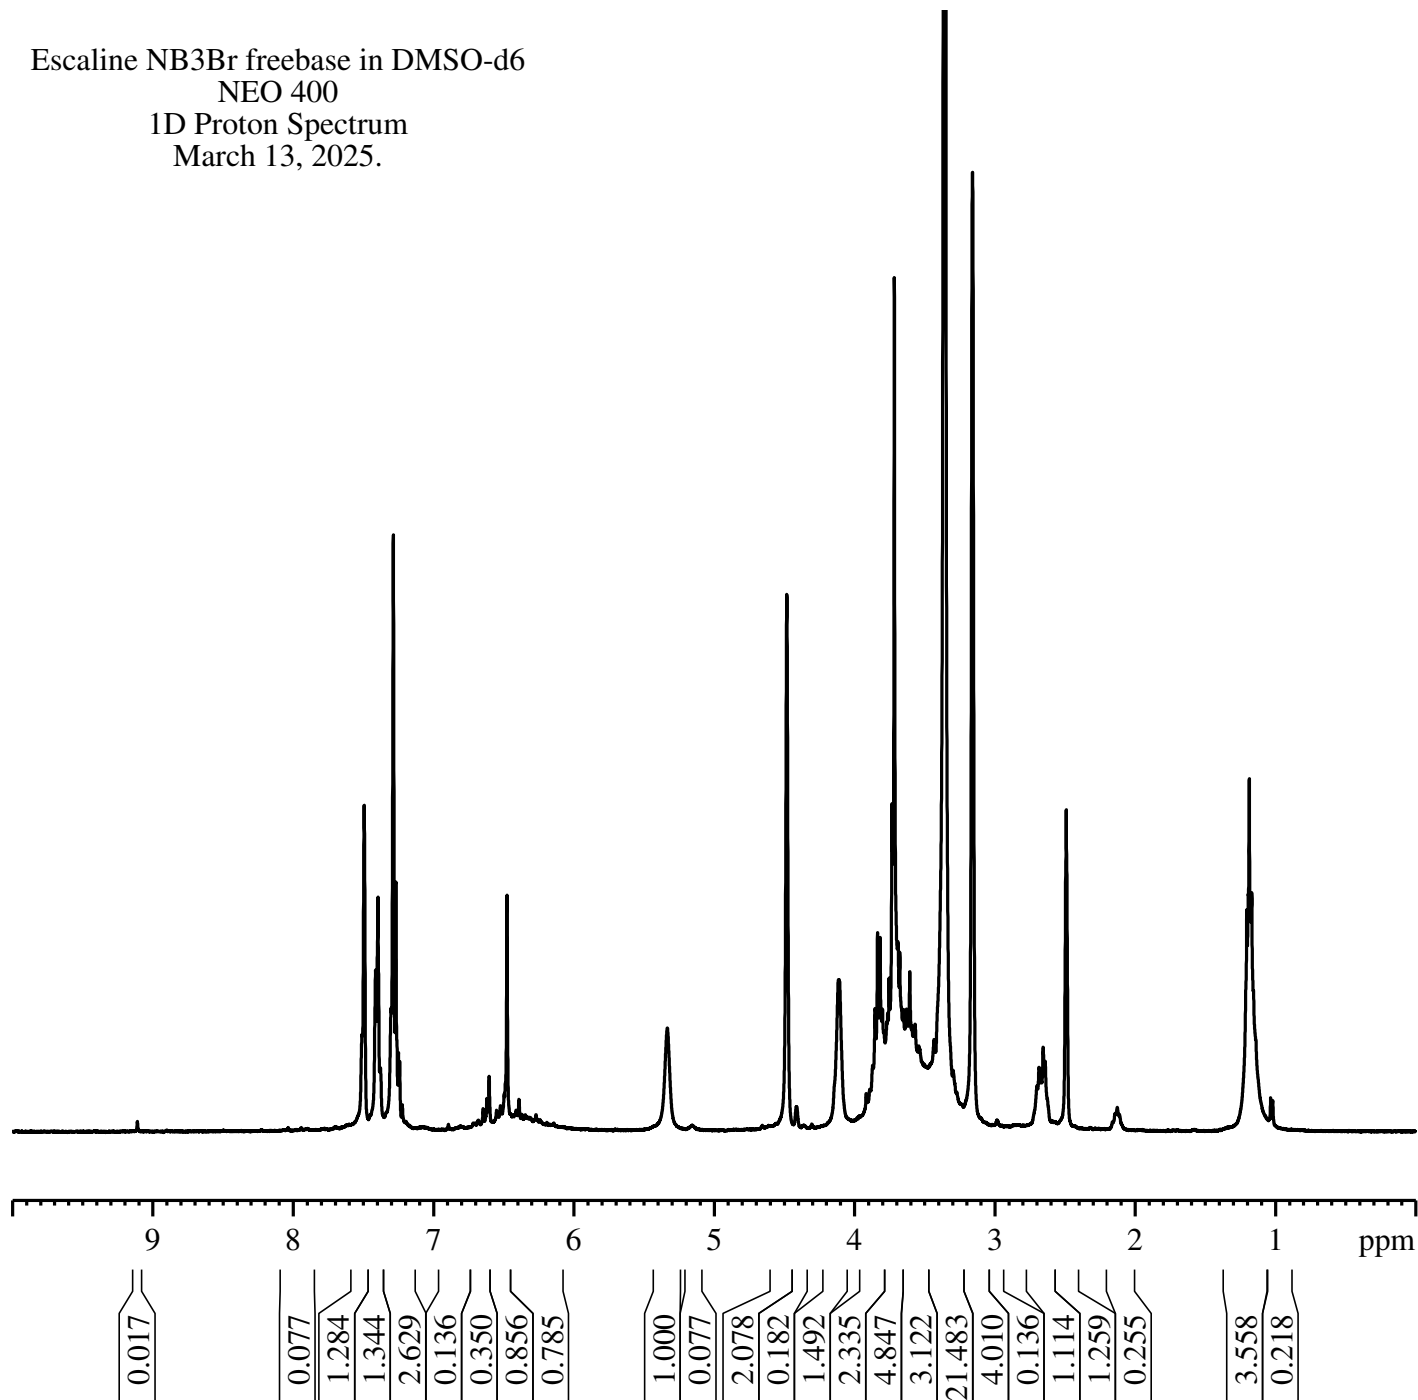

Escaline NB3Br freebase in DMSO-d6
NEO 400
1D Proton Spectrum
March 13, 2025.

7.494
7.413
7.396
7.301
7.286
7.268

6.476

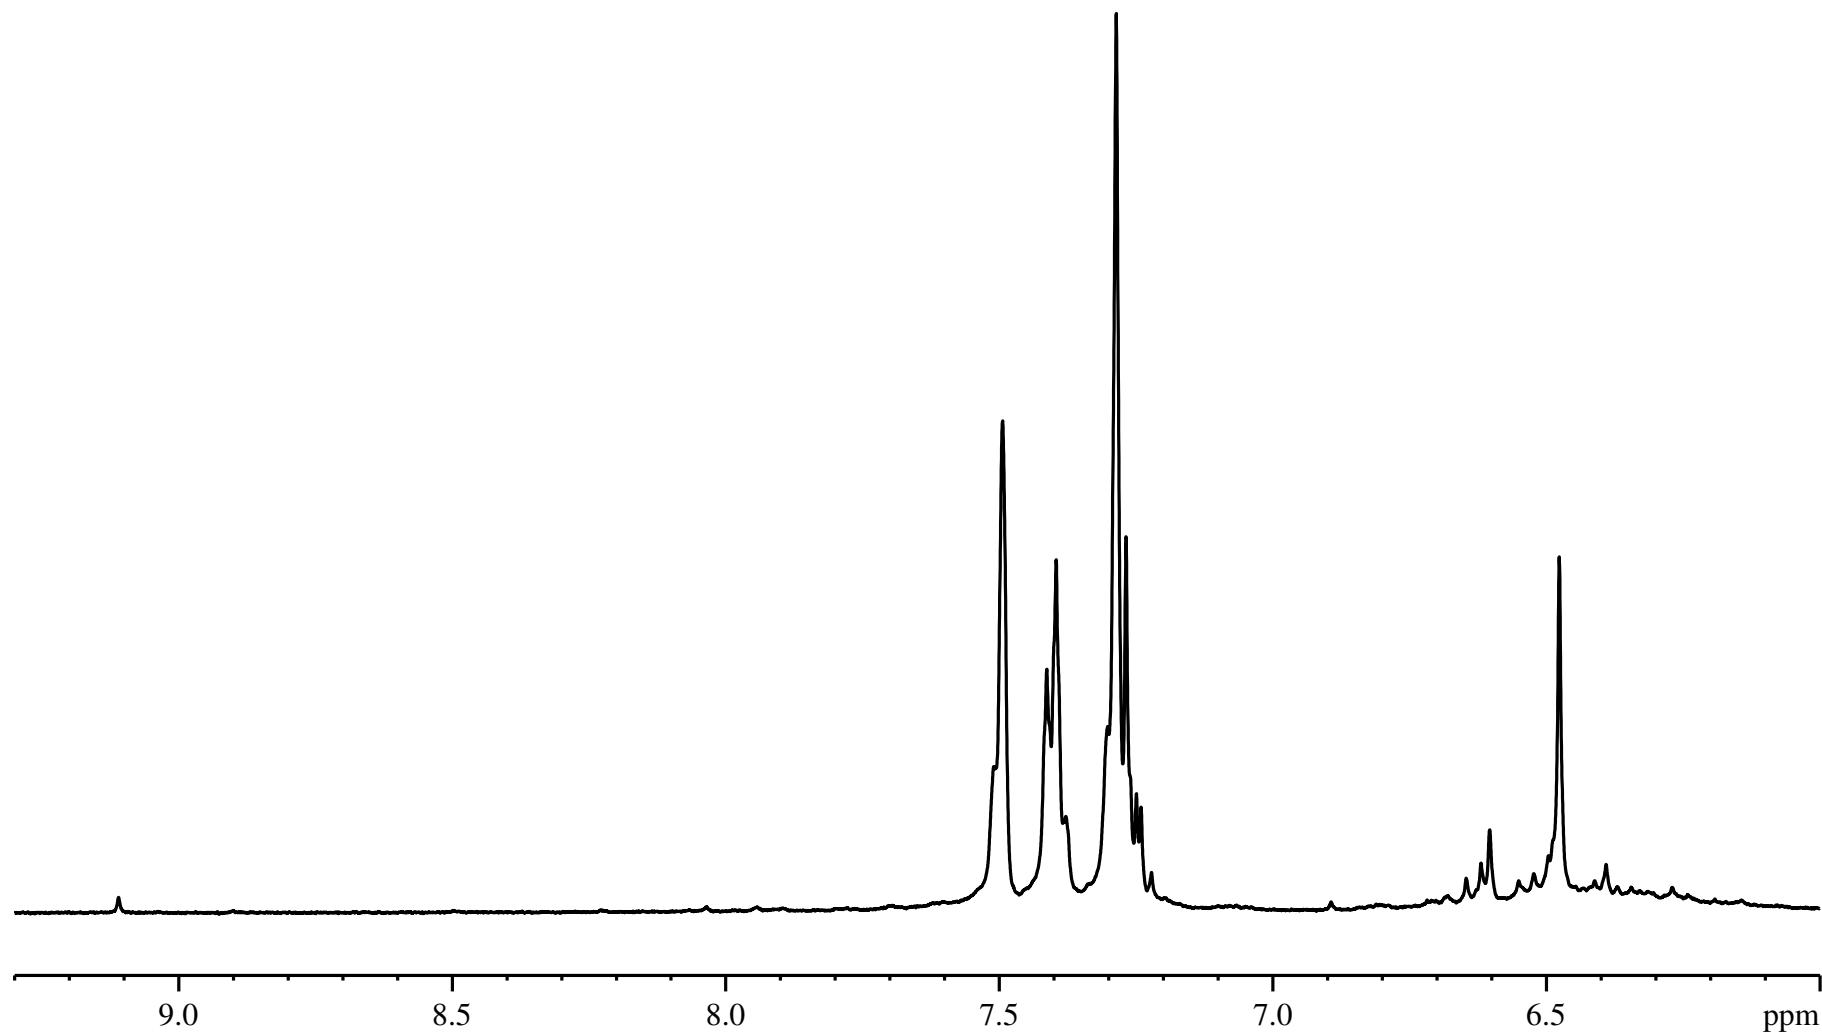

0.017

0.077

1.284

1.344

2.629

0.136

0.350

0.856

0.785

ppm

