



N,N-dipropyl Lysergamide tartrate
external_1H D2O



7.30
7.29
7.28
7.26
7.25
7.23
7.22
7.15
7.13
7.13
7.11
7.09
7.09
7.06
7.05
7.04
7.01
7.00
6.98
6.53
4.56
3.80
3.76
3.73
3.72
3.26
3.17
3.15
3.13
3.12
3.07
3.04
2.91
2.89
2.88
2.65
2.15
2.13
1.64
1.62
1.60
1.58
1.57
1.55
1.19
0.89

Current Data Parameters
NAME syntharise
EXPNO 2024081303
PROCNO 1

F2 - Acquisition Parameters
Date_ 20240813
Time 10.44 h
INSTRUM spect
PROBHD Z122623_0013 (
PULPROG zg30
TD 43588
SOLVENT D2O
NS 16
DS 2
SWH 8012.820 Hz
FIDRES 0.367662 Hz
AQ 2.7198913 sec
RG 20.2
DW 62.400 use
DE 17.38 use
TE 298.2 K
D1 5.00000000 sec
TD0 1
SFO1 400.1328009 MHz

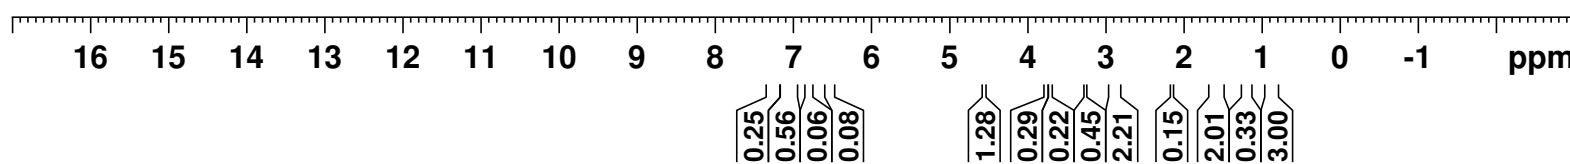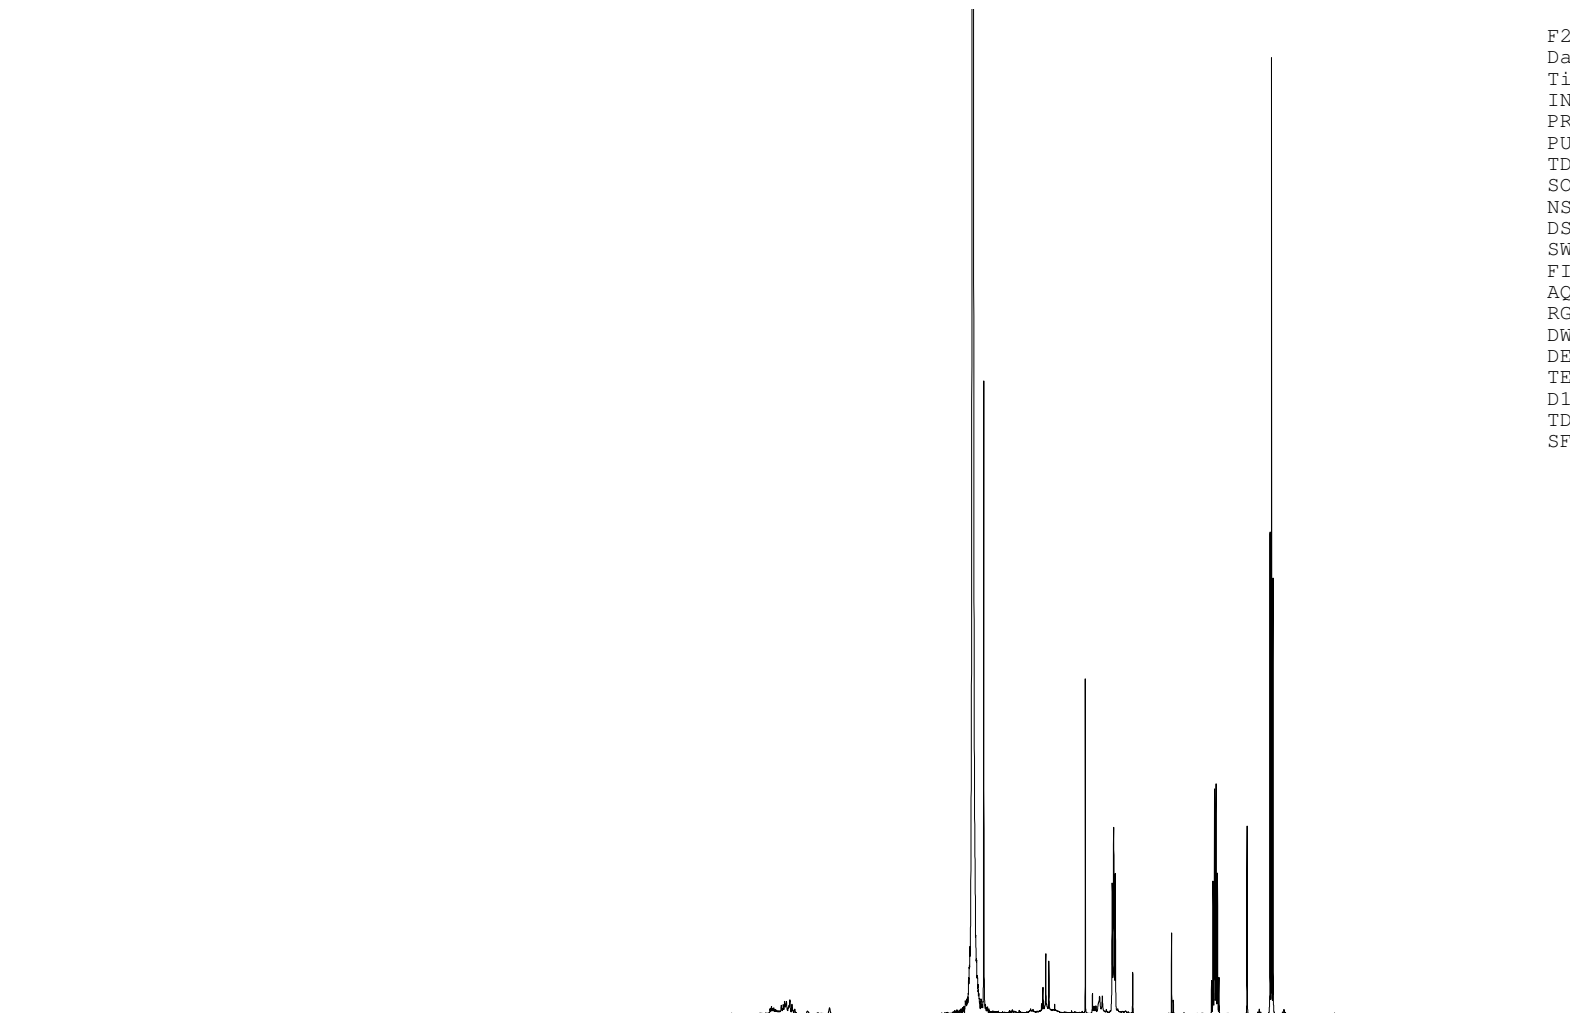


N,N-dipropyl Lysergamide tartrate
brown transparent sample with undissolved material at bottom
external_1H D2O {D:\data\sameer\nmr} sameer 16



Current Data Parameters
NAME syntharise
EXPNO 2024081303
PROCNO 1

F2 - Acquisition Parameters
Date_ 20240813
Time 10.44 h
INSTRUM spect
PROBHD Z122623_0013 (
PULPROG zg30
TD 43588
SOLVENT D2O
NS 16
DS 2
SWH 8012.820 Hz
FIDRES 0.367662 Hz
AQ 2.7198913 sec
RG 20.2
DW 62.400 use
DE 17.38 use
TE 298.2 K
D1 5.00000000 sec
TD0 1
SFO1 400.1328009 MHz

7.30
7.29
7.28
7.26
7.25
7.23
7.22
7.15
7.13
7.11
7.09
7.09
7.06
7.05
7.04
7.01
7.00
6.98
6.53

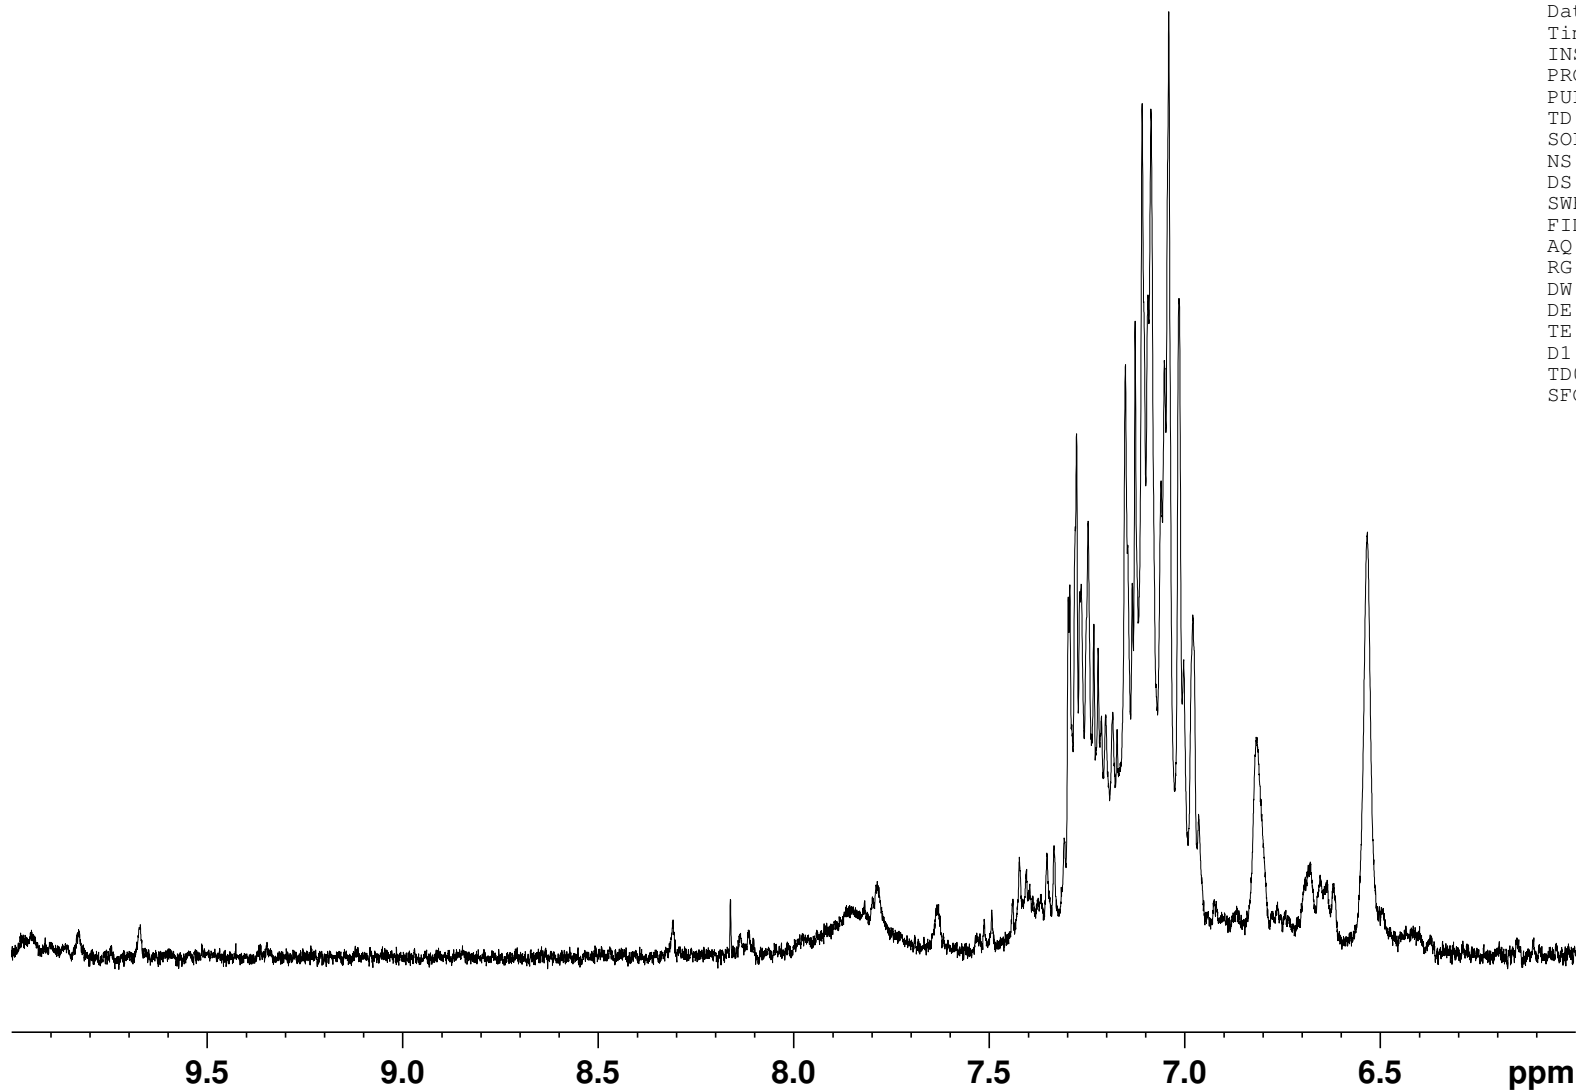


0.25
0.56
0.06
0.08

N,N-dipropyl Lysergamide tartrate
brown transparent sample with undissolved material at bottom
external_1H D2O {D:\data\sameer\nmr} sameer 16



Current Data Parameters
NAME syntharise
EXPNO 2024081303
PROCNO 1

F2 - Acquisition Parameters
Date_ 20240813
Time 10.44 h
INSTRUM spect
PROBHD Z122623_0013 (
PULPROG zg30
TD 43588
SOLVENT D2O
NS 16
DS 2
SWH 8012.820 Hz
FIDRES 0.367662 Hz
AQ 2.7198913 sec
RG 20.2
DW 62.400 use
DE 17.38 use
TE 298.2 K
D1 5.00000000 sec
TD0 1
SFO1 400.1328009 MHz

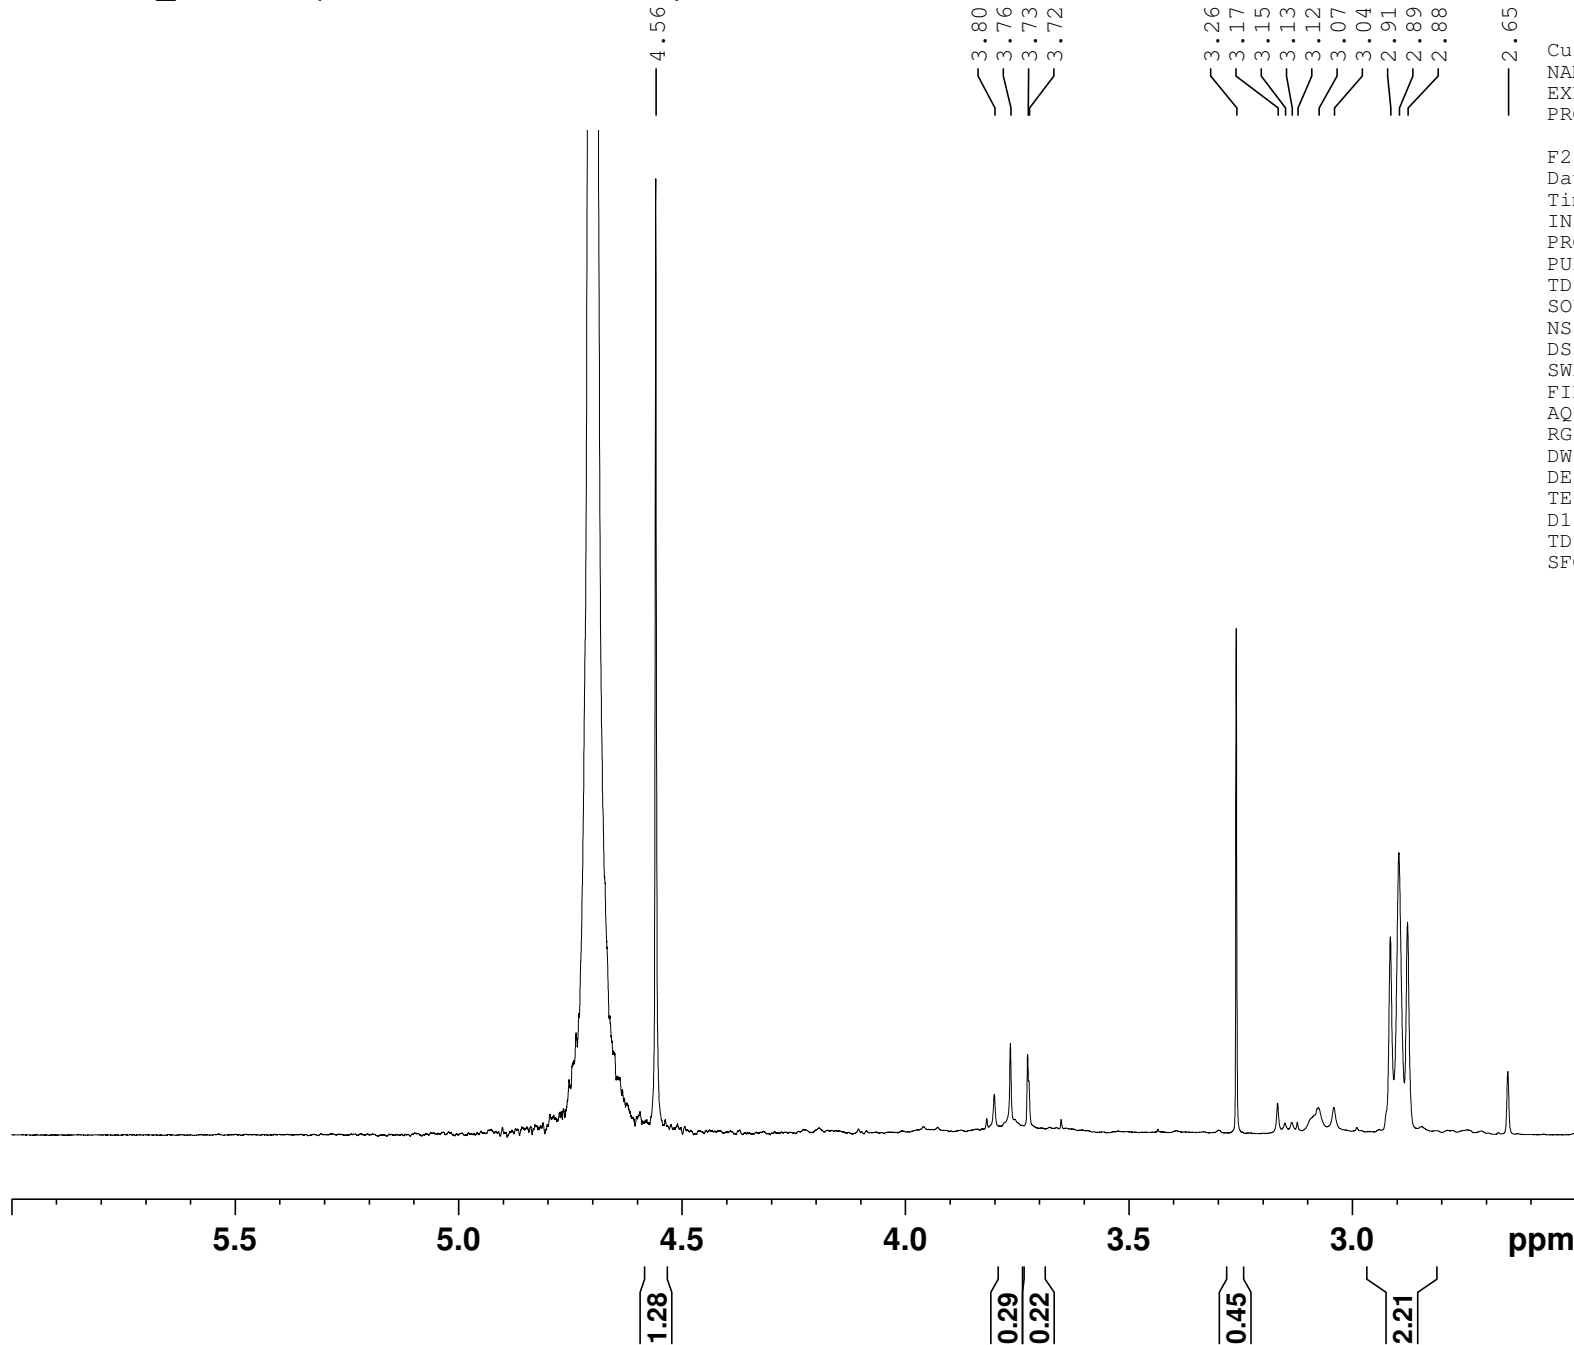

N,N-dipropyl Lysergamide tartrate
brown transparent sample with undissolved material at bottom
external_1H D2O {D:\data\sameer\nmr} sameer 16



Current Data Parameters
NAME syntharise
EXPNO 2024081303
PROCNO 1

F2 - Acquisition Parameters
Date_ 20240813
Time 10.44 h
INSTRUM spect
PROBHD z122623_0013 (
PULPROG zg30
TD 43588
SOLVENT D2O
NS 16
DS 2
SWH 8012.820 Hz
FIDRES 0.367662 Hz
AQ 2.7198913 sec
RG 20.2
DW 62.400 use
DE 17.38 use
TE 298.2 K
D1 5.00000000 sec
TD0 1
SFO1 400.1328009 MHz

